


USER MANUAL

HEPAZONE & HEPANOMAD

HepaZone Assembly Guide
Usage / Maintenance
Technical Support
Warranty


HEPAZONE

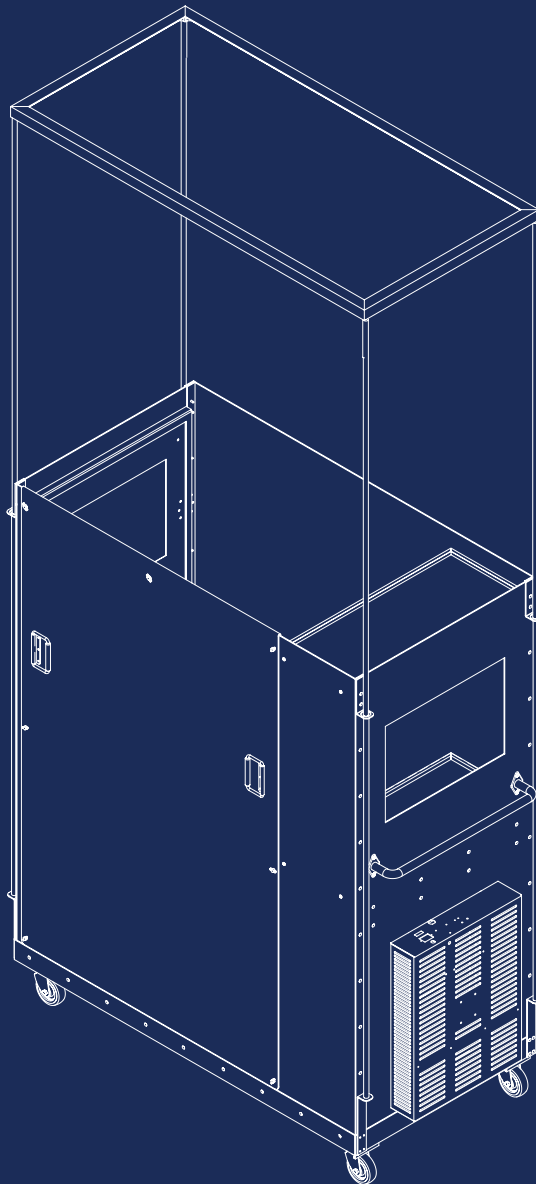


QUALITAIR

✉ info@qualitair.ca
🌐 www.qualitair.ca
☎ 1-877-444-8012


ASSEMBLY GUIDE

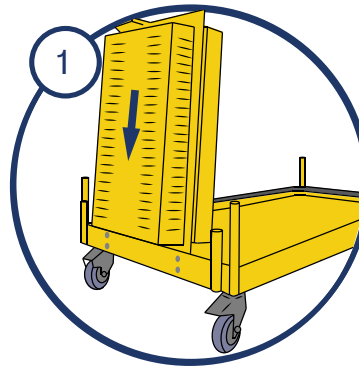

1
ATTACH THE HEPANOMAD
UNTO THE PLATFORM

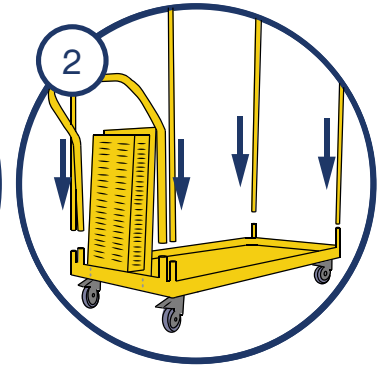


2
PUT THE 4 POLES AND THE
HANDLE IN PLACE

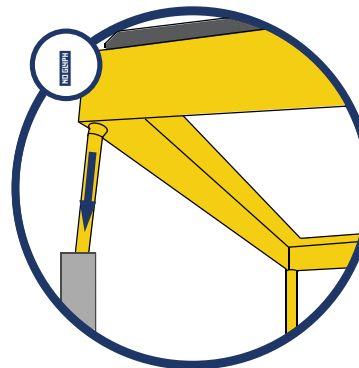


3
INSTALL THE TOP FRAME
ON TOP OF THE POLES




4
ATTACH THE CABIN TO THE
UPPER FRAME USING THE
VELCRO BANDS

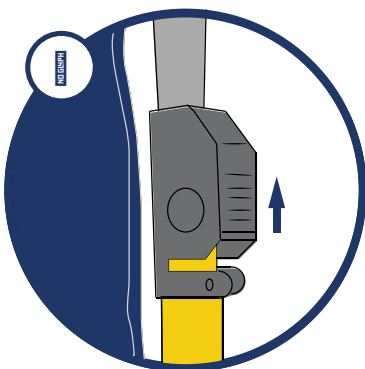

5
EXTEND THE POLES TO
THEIR FULL LENGTH

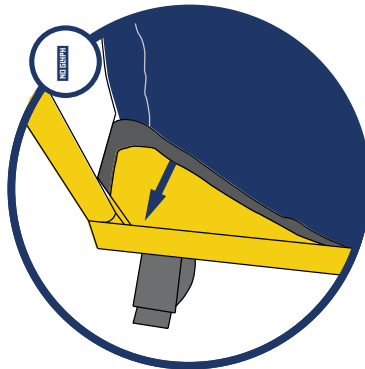

6
ATTACH THE CABIN TO THE
PLATFORM WITH THE VELCRO
BANDS

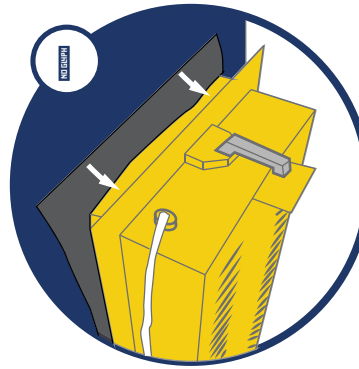


7
ATTACH THE CABIN TO
THE FAN USING THE
VELCRO BANDS



8
ATTACH THE CORNERS OF
THE CABIN TO THE 4 POLES
WITH THE VELCRO STRIPS

USAGE / MAINTENANCE

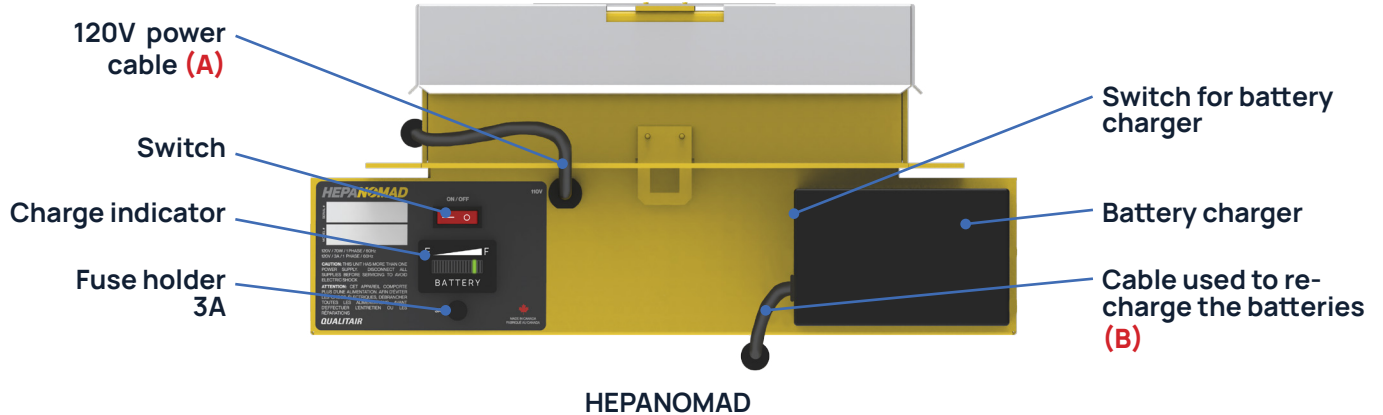

120V vs Battery Charger

- (A) 120V power cable
- (B) Cable used to recharge the batteries

Battery Recharging

1. Connect the battery charger to a wall outlet
2. Turn on the battery charger (switch on the battery charger)
3. Check the LED status on the charger (red: charging in progress, green: fully charged)

Battery Maintenance


4. **Always** charge the batteries when the unit is not in use (charger connected and turned on)
5. **Never** allow batteries to fully discharge (or they may need to be replaced)
6. **Ideal storage temperature:** 18-21°C/65-70°F

Note: If the batteries are too low, the charge indicator may behave differently. Like flashing red or orange. In the event that the batteries are completely discharged, the indicator may not light up.

In both cases, the batteries may need to be replaced.

Please contact us for more information.

HEPANOMAD

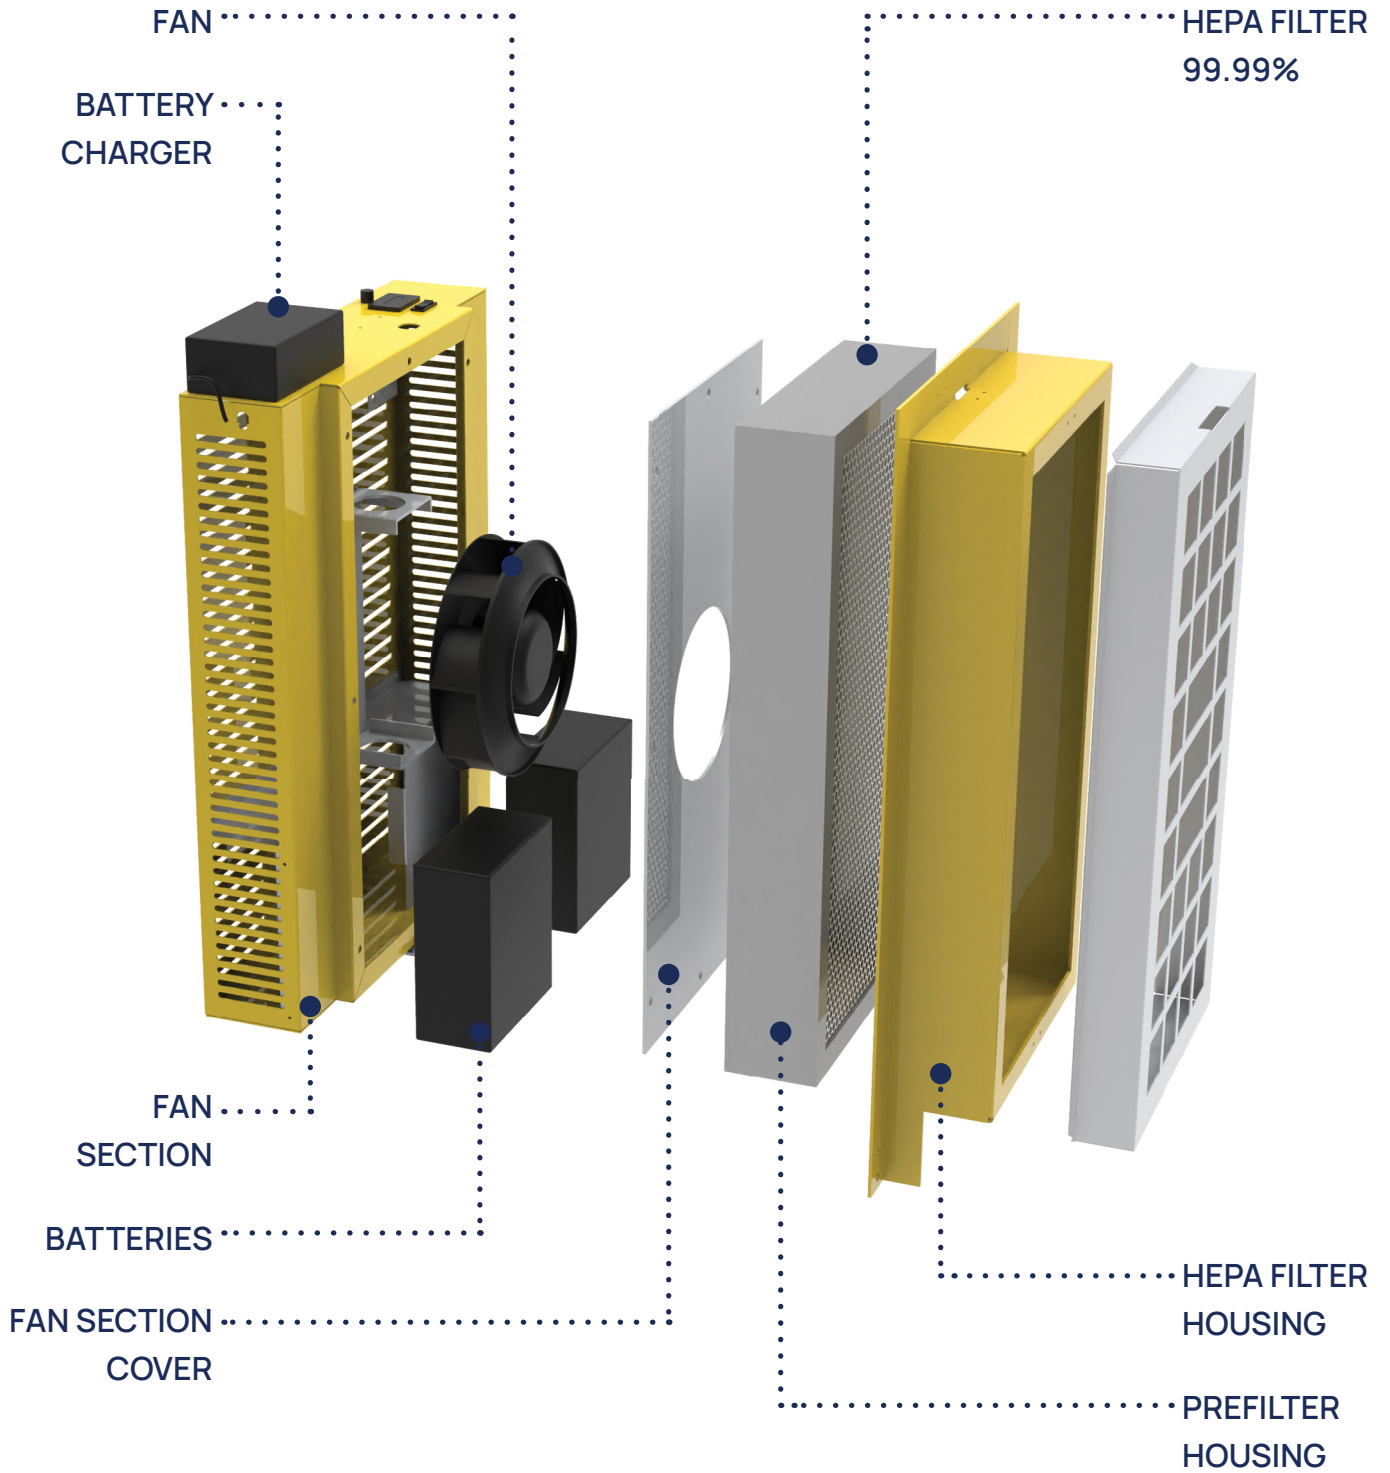

TECHNICAL SUPPORT

The fan does not start and the charge indicator is not lighting up

Check the fuse

Batteries don't seem to be charging

- 1- Is the charger powered on? (see point 3 of battery recharging)
- 2- If the indicator is flashing, see the next point

Indicator flashes red or red/orange

The batteries are probably dead. Please contact us for battery replacement procedure

Note: Even in the event that the batteries are defective, the HepaNomad can be operated using the 120V power cable (A)

For all other technical support requests, please contact us by email at service@qualitair.ca or by phone at 1 (877) 444-8012.

WARRANTY

Don't bother looking for the 20 page 'terms and conditions' document because we never wrote it.

Taking into account normal wear and tear, our HepaZone units are guaranteed for defects in materials and workmanship for the duration noted below from the date of purchase.

Defective product along with proof of purchase can be returned to Qualitair inc. within the prescribed time period for replacement or repair at our discretion.

HepaZone: 3 years

HepaZone M: 3 years

HepaZone remis à neuf: 1 year

***Batteries have a limited warranty of 90 days**

SHIPPING:

The customer is responsible for paying for return transport (return transport will be charged to the customer, unless the customer has been notified otherwise in advance). The product must be packaged appropriately. Qualitair cannot be held responsible for any damage done in transit.

Procedure for sending repairs:

Contact our team to obtain a return authorization number (RMA).

Charges may apply if:

- The problem results from improper use
- No problem is detected
- The device meets the quality standards of Qualitair inc.

Phone: 1-877-444-8012, 8:30 am - 4:30 pm EST

Email: info@qualitair.ca

If you are not completely satisfied, give us a call, we will help you.

QUALITAIR

✉ info@qualitair.ca

🌐 www.qualitair.ca

☎ 1-877-444-8012